

Building

Regulations Advisory Committee

Goods Shed North
733 Bourke Street, Docklands
Victoria, Australia 3008

PO Box 536, Melbourne
Victoria, Australia 3001

Phone: 1300 815 127

Fax: 03 9618 9062

Email: BRAC@vba.vic.gov.au

Website: vba.vic.gov.au

DX 210 299 Melbourne

Certificate of accreditation

NUCLAD EXTERIOR INSULATION AND FINISHING SYSTEM

Nutex Coatings
15 – 19 Black Street
OAKLEIGH EAST VIC 3166

has applied to the Building Regulations Advisory Committee for the accreditation of **NuCLAD Exterior Insulation and Finishing System**, as suitable for use as a wall cladding system in Class 1 and associated Class 10 buildings.


The Building Regulations Advisory Committee appointed under Division 4 of Part 12 of the *Building Act 1993* has examined the application and determined that **NuCLAD Exterior Insulation and Finishing System** complies with Performance Requirements:

P2.1.1 and P2.2.2

of Volume Two of the *National Construction Code - Building Code of Australia 2011* as adopted by the *Building Regulations 2006*, to the extent that those Clauses refer to the structural stability, resistance to wind action and rainwater action, and weatherproofing of the product, subject to the following conditions:

1. This accreditation applies in the State of Victoria and is limited to –
 - a. Class 1 and 10 buildings.
 - b. Installation height up to a maximum of 6m to the underside of eaves and 8.5m to the ridge height.
 - c. Installation width of the building including verandas, excluding eaves, up to a maximum of 16m.
 - d. Installation length of the building up to a maximum of five times the building width.
 - e. Buildings with a maximum roof pitch of 35 degrees.
 - f. Buildings built in Region A, non cyclonic wind classes N1 – N2 as per Australian Standard AS 4055 - 2006.
2. The product must be installed, including rendering, in accordance with the NuCLAD EIFS technical Manual (document Number TM001, Version 2 as provided by NuCLAD).
3. The product must only be used with the Watergate permeable sarking membrane behind the panels and Aluband/Aluminium window sealing system.

Signature:

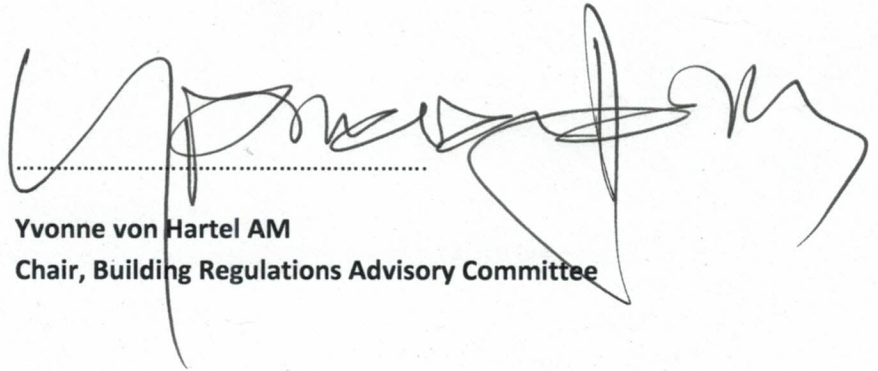

.....

Yvonne von Hartel AM
Chair, Building Regulations Advisory Committee

Certificate Number:

V/12/04

Date of issue:

30 October 20012

Date of amendment:

20 September 2017

Reason for amendment:

To update references to performance requirements.